

JSZ3 Series  
Time Delay Relay

---

User Instruction

---

## **Safety Warning**

---

- ① Only professional technicians are allowed for installation and maintenance.
- ② Installation in any damp, condensed-phase environment with inflammable and explosive gas is forbidden.
- ③ When the product is being installed or maintained, the power must be switched off.
- ④ You are prohibited from touching the conductive part when the product is operating.
- ⑤ The product shall be stored, installed and used in accordance with the rated control power supply voltage and specified conditions indicated in the user instructions.

## 1 Use Purpose

JSZ3 series time delay relay ("relay" in short) is mainly used as time control component in the control circuit with AC frequency of 50Hz/60Hz, rated control supply voltage up to 380V and DC rated control supply voltage up to 24V for connecting and disconnecting the circuit at preset time.

## 2 Key Technical Parameters

Table 1 Ambient Conditions

Normal use conditions	Ambient temp.: -5°C~+40°C; average value within 24h not exceeding +35°C; altitude not exceeding 2,000m.
Atmospheric conditions	RH shall not exceed 50% when maximum temperature is +40°C; in case of lower temperature, higher RH is allowed. Measures should be taken against occasional condensation due to temperature change.
Installation category	II
Transport and storage conditions	-25°C~+55°C

Table 3 Main Circuit and Auxiliary Circuit Technical Parameters

No.	Product model	JSZ3A-, JSZ3C-, JSZ3F, JSZ3F-2Z, JSZ3K, JSZ3Y, JSZ3R		
1	Rated control supply voltage $U_s$ (V), fR (Hz)	AC36V, AC110V, AC127V, AC220V, AC240V, AC380V, 50Hz/60Hz; DC24V		
2	Allowable fluctuation range of rated control power supply voltage	85% $U_s$ ~110% $U_s$		
3	Agreed free air heating current $I_{th}$ (A)	5		
4	Rated operating voltage $U_e$ (V)	AC240V	AC415V	DC220V
5	Use type under rated operating voltage and rated operating current $I_e$ (A)	AC-15 0.75A	AC-15 0.47A	DC-13 0.27A
6	Rated insulation voltage $U_i$ (V)	415V		
7	Rated impulse withstand voltage $U_{imp}$ (kV)	4		
8	Enclosure protection class (if applicable)	IP20		
9	Pollution class	Class 3		
10	Type and maximum value of short circuit protection	RT36-00/6A		
11	Electrical life / mechanical life (10,000 times)	10/100		

Table 2 Specifications and Main Technical Parameters

Model	JSZ3A-	JSZ3C-	JSZ3F	JSZ3F-2Z	JSZ3K	JSZ3Y	JSZ3R
Delay type	Multi-span			Single-span			
Mounting type	Equipment type, panel type, Din-rail						
Indication form	Indicator						
Operation method	Power-on delay			Power-off delay	Disconnection delay	Star/delta start delay	Shuttling (cycling) delay
Delay range	A: 0.05s~0.5s/5s/30s/3min B: 0.1s~1s/10s/60s/6min C: 0.5s~5s/50s/5min/30min D: 1s~10s/100s/10min/60min		E: 5s~60s/10min/60min/6h F: 0.25min~2min/20min/2h/12h G: 0.5min~4min/40min/4h/24h		0.1s~1s 0.5s~5s 1s~10s 2.5s~30s	5s~60s 10s~120s 15s~180s	0.5s~6s/60s 1s~10s/10min 2.5s~30s/30min 5s~60s/60min
	The actual maximum delay value is no less than 90% of the nominal delay value and no greater than 110% of the the nominal delay value. The minimum delay value is no greater than 10%±50ms of the nominal delay value.						
Reset time	≤1s						
Number of contacts	Delay 2 change-over sets	Delay 1 change-over sets; Instantaneous 1 change-over sets	Delay 1 change-over sets	Delay 2 change-over sets	Delay 1 change-over sets		


**Table 4 Immunity to Interference**

No.	Test type	Test level
1	Electrostatic discharge immunity test	8kV (air discharge)
2	RF electromagnetic field immunity test	10V/m
3	Electrical fast transient/burst immunity test	2kV/5kHz on the power supply side
4	Surge immunity test	1kV (wire to wire)


### 3 Installation

3.1 Overall, installation size: see Fig 1~Fig 4, unit: mm.


3.2 Wiring diagram: see Figure 5~Figure 11, work sequence diagram: see Figure 12.




**Figure 1 Overall Size of JSZ3A-, C-, F, K, Y**




**Figure 2 Overall Size of JSZ3R**




**Figure 3 Hole Size of Molded Case Mounting**




**Figure 4 Hole Size of Panel Mounting**




**Figure 5 wiring diagram of JSZ3A-**




**Figure 6 wiring diagram of JSZ3C-**




**Figure 7 wiring diagram of JSZ3F**




**Figure 8 wiring diagram of JSZ3F-2Z**




**Figure 9 wiring diagram of JSZ3K**



**Figure 10 wiring diagram of JSZ3Y**




**Figure 11 wiring diagram of JSZ3R**

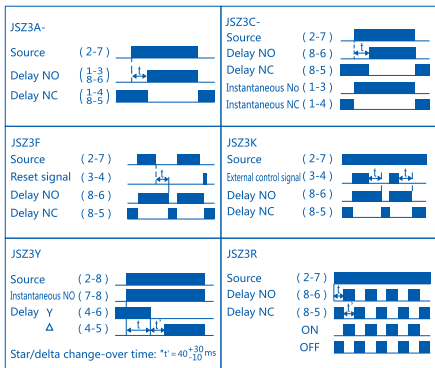


**Figure 12 Work sequence diagram**


**3.3 Product delay range selection and setting (take JSZ3A-B with delay range 1s as an example).**



1) Turn the knob clockwise to the maximum extent




2) Pull off the transparent knob




3) Take off two nameplates

---





4) Turn the time frame switch to the corresponding position (2,4) according to the time setting on the left side of the product.



5) Mount the nameplate, and place the side with 1s as the maximum scale to the outside

---



6) Put on the transparent knob, the small notch on the knob should form a  $18^\circ$  angle against the maximum scale value on the nameplate.

---

Notes:

- 1) The relay together with CZS08X-E base can realize molded case or rail mounting; and can realize panel mounting with FM8858 or FM8858X;
- 2) The nameplate of the relay gives the schematic scale for reference only and cannot represent the actual delay time. When using the relay, please check the delay value;
- 3) For power-off delay relay with nominal delay value no more than 1min, the shortest power-on time shall be no less than 2s; if the nominal delay value is greater than 1min, the shortest power-on time shall be no less than 5s;
- 4) For power-off delay relay, the shortest control signal input time shall be no less than 50ms;
- 5) The power-off delay time relay with ex-factory reset may change into a motion state during transportation and installation due to impact, therefore, remember to power on the relay on before use.

## 4 Maintenance

4.1 The terminal of the protector should be tightened on a regular basis.

4.2 In case of squeezing the product, the product should be stored in a well-ventilated place.

**Table 5 Fault Analysis and Troubleshooting**

Symptoms	Cause analysis	Troubleshooting method
The indicator is not on.	Check if the wire is securely connected with the terminal, and the terminal of the power end is correctly wired.	Wire the product securely according to the product manual.
The relay does not change over at the delayed period of time.	Check if the wiring of the relay is correct, or if the input voltage is too low.	Wire the product securely according to the product manual; confirm if the input voltage is equal to the rated control supply voltage of the product.



## **5** **Environmental Protection**

In order to protect the environment, the product or product parts should be disposed of according to the industrial waste treatment process, or be sent to the recycling station for assortment, dismantling and recycling according to local regulations.

---

# CHINT

## QC PASS

JSZ3 Series  
Time Delay Relay  
IEC/EN 60947-5-1

JDQ Check 10

---

Test date: Please see the packing

---

ZHEJIANG CHINT ELECTRICS CO., LTD.

---

# CHINT

CHINT ELECTRICS

## JSZ3 Series Time Delay Relay User Instruction

### Zhejiang Chint Electric Co., Ltd.

Add: No.1, CHINT Road, CHINT Industrial Zone, North Baixiang,  
Yueqing, Zhejiang 325603, P.R.China

E-mail: [global-sales@chint.com](mailto:global-sales@chint.com)

Website: <http://en.chint.com>

